
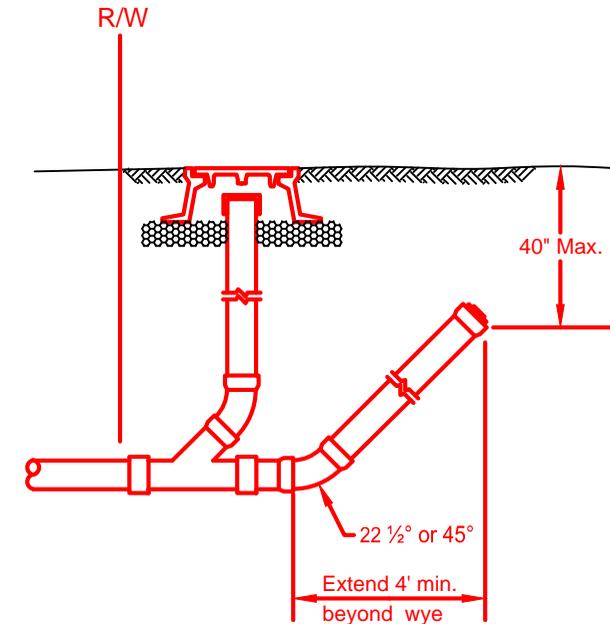


Chesapeake modifications to Regional Standards Third Edition

1. The wye shall be located at the property line.
2. Lateral pipe material shall be in accordance with Volumes I & III of PFM.
3. Where the lateral is >40" deep at the right-of-way, extend beyond wye to provide 40" max.

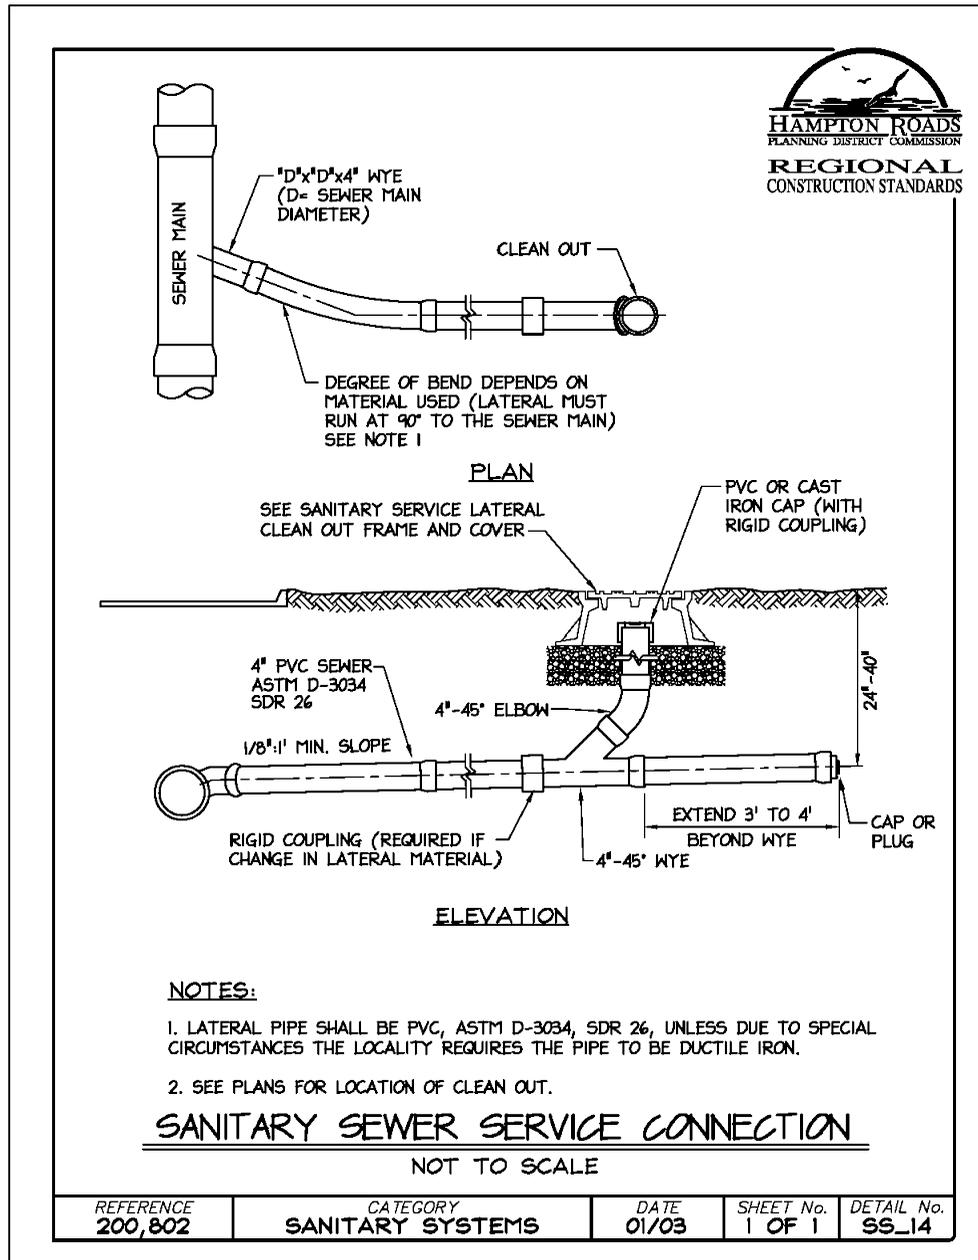

Regional Construction
Standards
Third Edition

Chesapeake VIRGINIA		DESIGN AND CONSTRUCTION STANDARDS	
		SANITARY SEWER SERVICE CONNECTION	
08/15/03	REV. FOR INTERNET 2003	DR. BY:	DATE:
DATE	REVISIONS	CHK. BY:	DATE:
		APP. BY:	DATE:

SS_14