


Chesapeake modifications to Regional Standards Third Edition

1. The width of select bedding stone will be based on the inside pipe diameter plus (2) feet. The depth required will be six (6) inches for pipes less than forty-eight (48) inches and One (1) foot for larger pipe sizes or as determined by the Engineer. (PFM Volume III \ Division 16 - Bidding Material (Drainage and Utility Pipe) )



Regional Construction Standards Third Edition

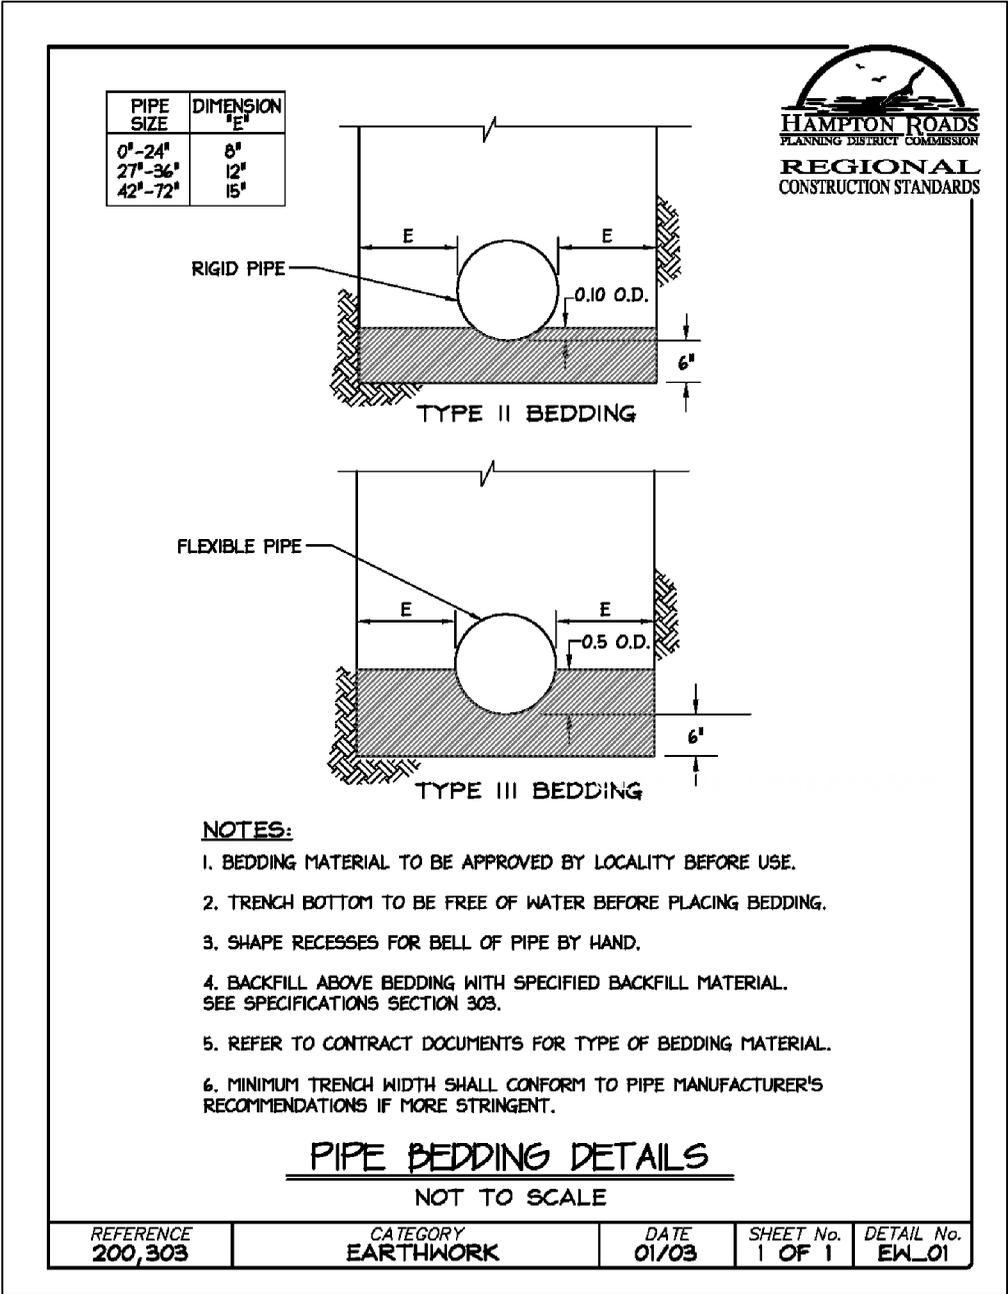

DESIGN AND CONSTRUCTION STANDARDS

PIPE BEDDING DETAILS

08/15/03	REV. FOR INTERNET 2003	DR. BY:	DATE:
DATE	REVISIONS	CHK. BY:	DATE:
		APP. BY:	DATE:

**EW\_01**

01

APPROVED FOR THE WEB

Utility Engineer

Date