


NOTES:

1. CONCRETE SHALL HAVE A COMPRESSIVE STRENGTH OF 3000 PSI @ 28 DAYS, CONTAIN 4% MIN – 6% MAX AIR ENTRAINMENT AND BE PLACED WITH A 3.50 – 4.50 SLUMP IN ACCORDANCE WITH ACI 301.
2. REINFORCING STEEL RODS SHALL CONFORM TO ASTM A615, GRADE 60.
3. ANCHOR BOLTS SHALL CONFORM TO ASTM A193, GRADE B8M, TYPE 316 STAINLESS STEEL.
4. MAXIMUM OF 2 CLUSTER BOX UNITS PER CONCRETE PAD WITH A MINIMUM OF 2 INCHES BETWEEN THE UNITS.
5. CLUSTER MAILBOX EASEMENT SHALL EXTEND A MINIMUM OF 24 INCHES BEYOND THE CONCRETE PAD.
6. MODE OF DELIVERY AGREEMENT AND BUILDER AND DEVELOPER INFORMATION PACKET CAN BE FOUND AT THE FOLLOWING LINK:
http://www.cityofchesapeake.net/Assets/documents/departments/development_permits/builder-and-developer-information-packet.pdf

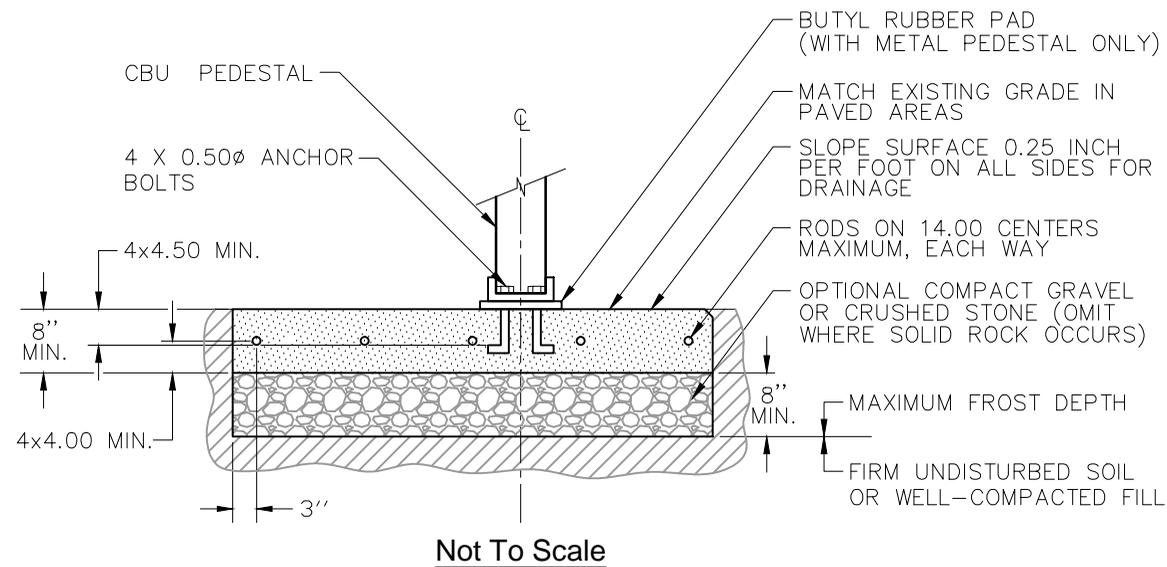

DESIGN AND CONSTRUCTION STANDARDS

CLUSTER BOX
CONCRETE PAD

DR. BY: RTB	DATE: 10/6/16
CHK. BY:	DATE:
APP. BY:	DATE:

MB-1

DATE REVISIONS