


Chesapeake modifications to Regional Standards Third Edition

1. A minimum of one 4 inch adjustment ring to be added at time of construction to allow for future adjustments.
2. After grouting lift holes they shall be field coated as noted in note 3.
3. Casting to be placed over the outlet pipe.
4. Special designs required for manholes less than 30 inches from rim to invert.
5. Watertight insert to be provided with casting in accordance with Volumes I & III of PFM.

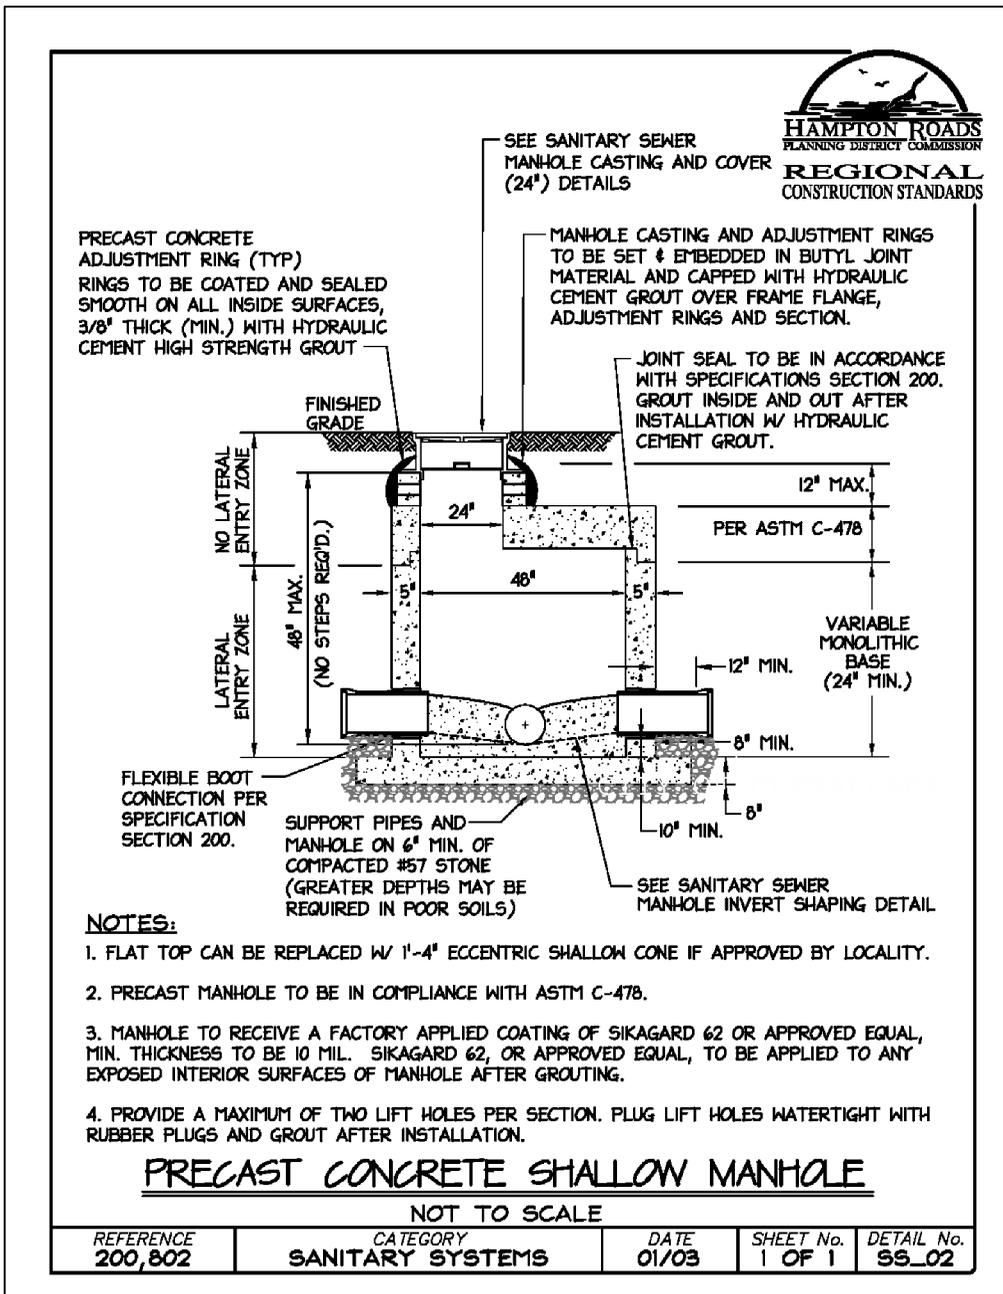

Regional Construction
Standards
Third Edition

		DESIGN AND CONSTRUCTION STANDARDS			
		PRECAST CONCRETE SHALLOW MANHOLE			
DR. BY:	DATE:	SS_02	03		
08/15/03	REV. FOR INTERNET 2003			CHK. BY:	DATE:
DATE	REVISIONS			APP. BY:	DATE:

APPROVED FOR THE WEB

Utility Engineer

Date