


Chesapeake modifications to Regional Standards Third Edition

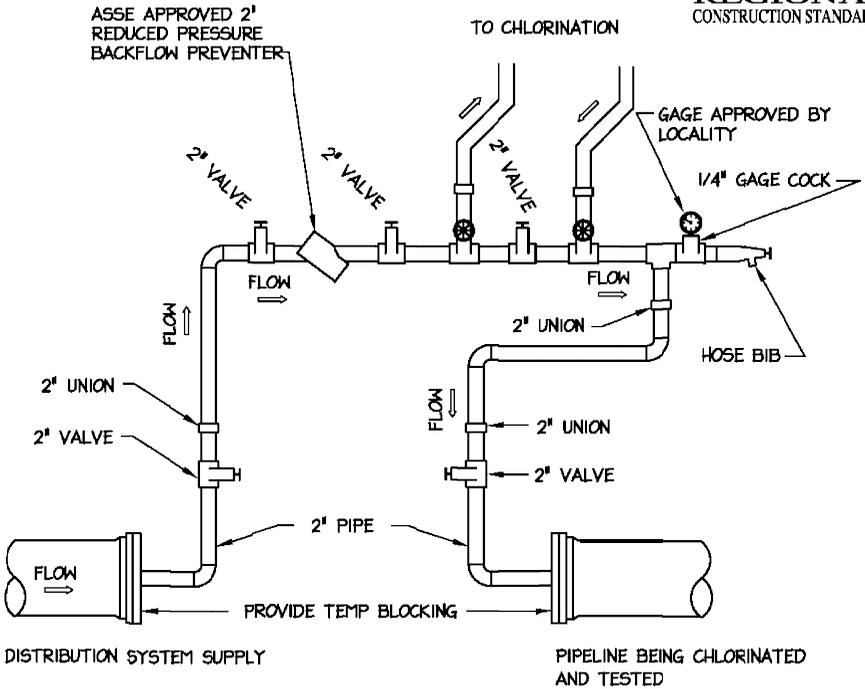

- NOTES:**
1. ALL VALVES TO BE 2" BALL VALVES.
 2. ALL PIPING SHALL BE PROTECTED FROM THE WEATHER DURING FREEZING CONDITIONS.
 3. BACKFLOW PREVENTER SHALL BE INSTALLED AND TESTED IN ACCORDANCE WITH THE LOCALITY'S APPROVED CROSS CONNECTION CONTROL PROGRAM.
 4. THE RPZ SHALL NOT BE INSTALLED IN A PIT OR AREA SUBJECT TO FLOODING.

TEMPORARY MANIFOLD FOR TEST AND CHLORINATION
NOT TO SCALE

REFERENCE (NONE)	CATEGORY WATER DISTRIBUTION	DATE 01/03	SHEET No. 1 OF 1	DETAIL No. WD_09
---------------------	--------------------------------	---------------	---------------------	---------------------

Regional Construction Standards Third Edition

Chesapeake VIRGINIA	DESIGN AND CONSTRUCTION STANDARDS	
	TEMPORARY MANIFOLD FOR TEST AND CHLORINATION	
08/15/03	REV. FOR INTERNET 2003	DR. BY: / DATE: / CHK. BY: / DATE: /
DATE	REVISIONS	APP. BY: / DATE: /

WD_09

APPROVED FOR THE WEB _____ / /
Utility Engineer Date