


# Chesapeake modifications to Regional Standards Third Edition

1. No thrust block to be installed on the tee for the hydrant.
2. Valves to be MJ X MJ and located 3 feet from the water main.
3. Minimum distance behind curb to be 18 inches.
4. Maximum distance as allowed by Fire Department.

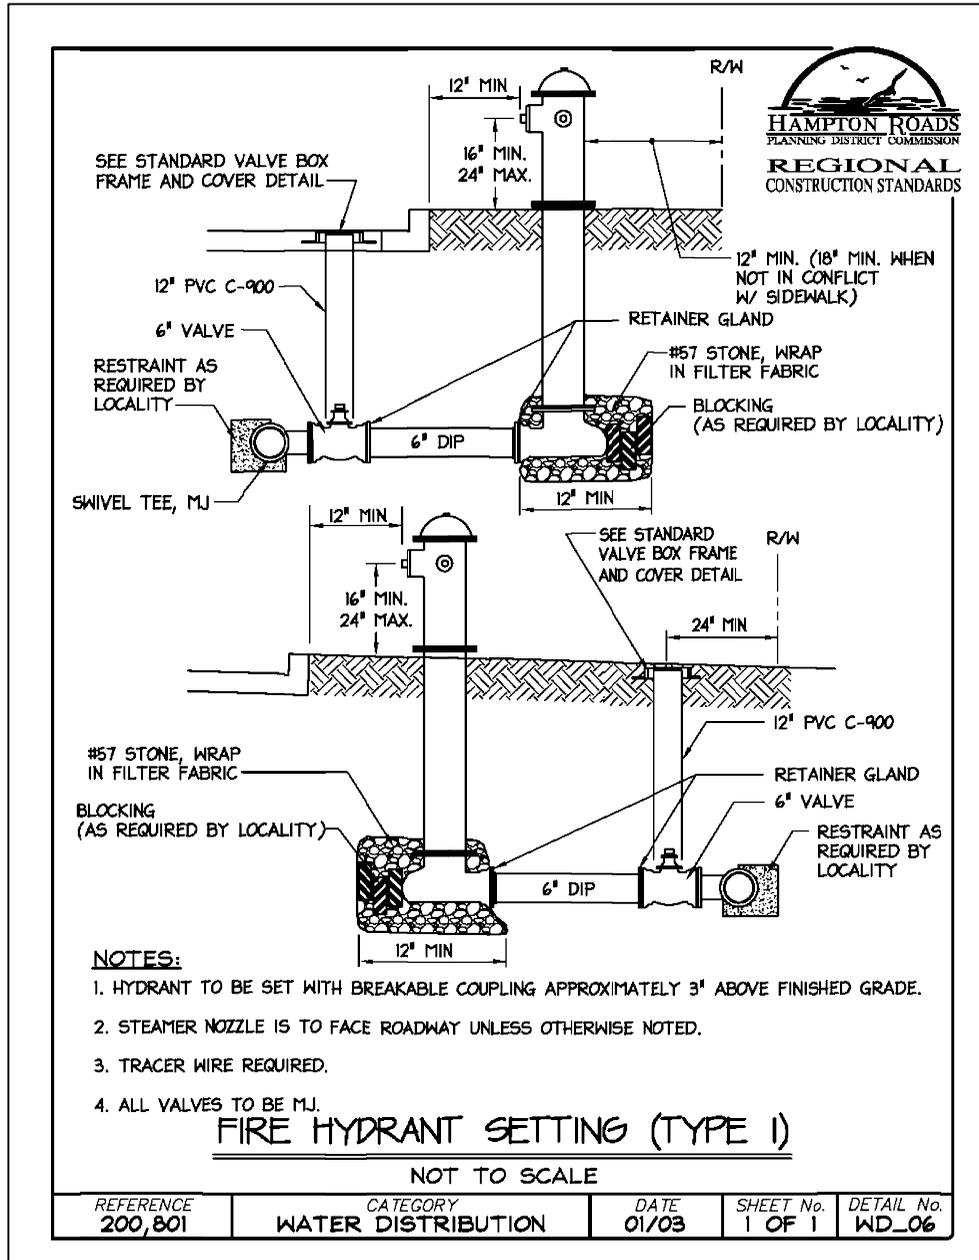

Regional Construction Standards Third Edition

	DESIGN AND CONSTRUCTION STANDARDS	
	<b>FIRE HYDRANT SETTING (TYPE I)</b>	
08/15/03	REV. FOR INTERNET 2003	DR. BY: DATE:
DATE	REVISIONS	CHK. BY: DATE:
		APP. BY: DATE:

**WD\_06**

APPROVED FOR THE WEB

Utility Engineer

Date