


# Chesapeake modifications to Regional Standards Third Edition

1. No thrust block to be installed on the tee for the hydrant.
2. Valves to be MJ X MJ and located 3 feet from the water main.
3. Minimum distance behind curb to be 18 inches.
4. Maximum distance as allowed by Fire Department.

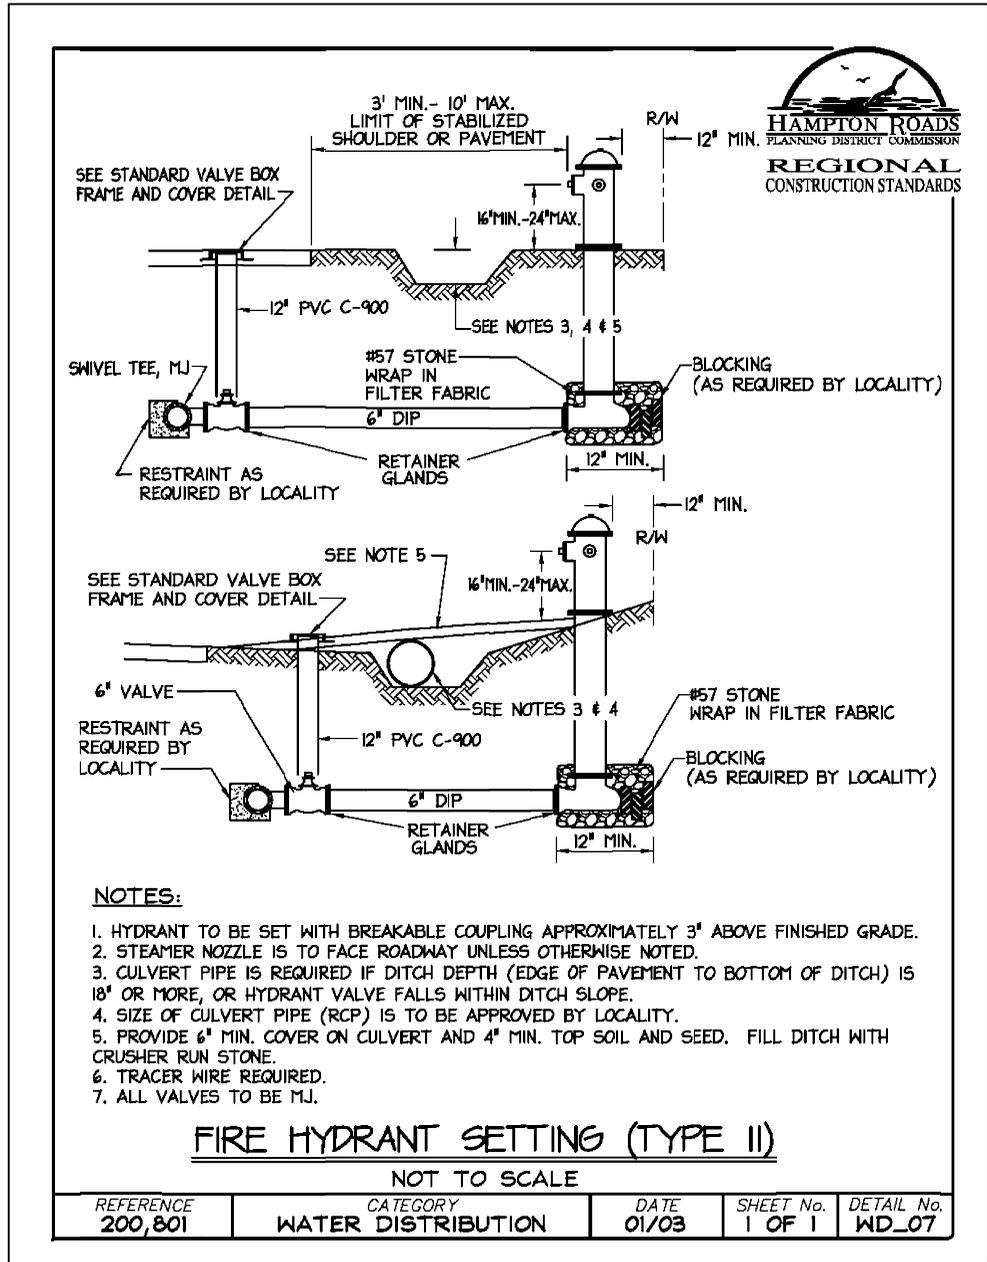

**Regional Construction Standards Third Edition**

<b>Chesapeake VIRGINIA</b>	<b>DESIGN AND CONSTRUCTION STANDARDS</b>				
	<b>FIRE HYDRANT SETTING (TYPE II)</b>				
	DR. BY:	DATE:	<b>WD_07</b>		
08/15/03	REV. FOR INTERNET 2003	CHK. BY:			DATE:
DATE	REVISIONS	APP. BY:			DATE:

APPROVED FOR THE WEB

Utility Engineer

Date