

CONSTRUCTION NOTES:

CRACK CONTROL JOINTS TO BE PROVIDED AT INTERVALS EQUAL TO WIDTH OF SIDEWALK EXTENDING INTO CONCRETE FOR 1/4 OF DEPTH.


EXPANSION JOINTS TO BE INSTALLED AT INTERVALS NOT EXCEEDING 50', AND AT JUNCTION POINTS OF CURBS AND ENTRANCES, AND ON BOTH SIDES OF ALL SIDEWALK SECTIONS CONTAINING UTILITIES. PREMOLD-ED, 1/2" JOINT FILLER IS TO BE USED EXTENDING FROM BOTTOM OF SLAB TO 1/4" OF ITS TOP SURFACE.

AS SOON AS SURFACE IRREGULARITIES ARE REMOVED, AND A LIGHT TRANSVERSE BROOM FINISH GIVEN, A LIQUID MEMBRANE SEAL OR OTHER APPROVED CURING MEDIUM IS TO BE APPLIED.

SIDEWALKS ACROSS ENTRANCES SHALL HAVE A DEPTH OF SEVEN INCHES (7") WITH A MAXIMUM SLOPE OF 1":1'.

THE CONTRACTOR SHALL PREVENT THE TEMPERATURE AT THE SURFACE OF THE CONCRETE FROM FALLING BELOW 40°F DURING THE FIRST 72 HOURS IMMEDIATELY FOLLOWING CONCRETE PLACEMENT. PROTECTIVE MATERIAL SHALL BE LEFT IN PLACE FOR AN ADDITIONAL 48 HOURS IF FREEZING AIR TEMPERATURES ARE EXPECTED TO CONTINUE.

ANY ASPECT OF CONSTRUCTION NOT COVERED HEREIN IS TO BE PER THE CURRENT V.D.H&T, ROAD AND BRIDGE SPECIFICATIONS, SEC. 504.

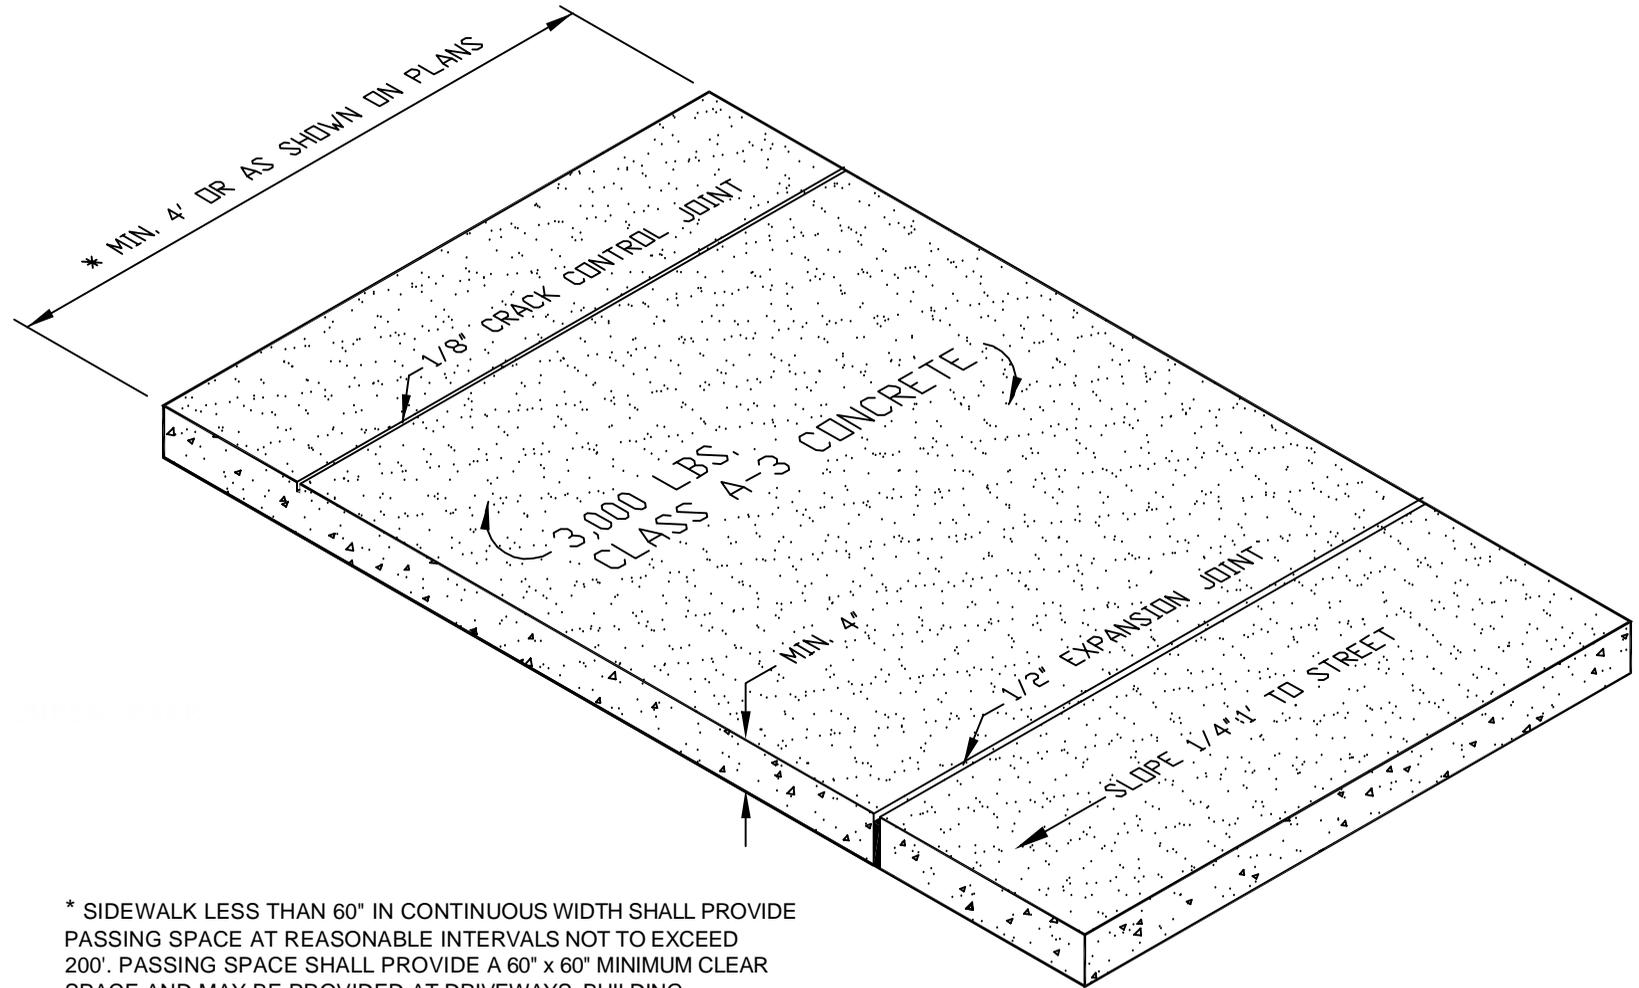

\* SIDEWALK LESS THAN 60" IN CONTINUOUS WIDTH SHALL PROVIDE PASSING SPACE AT REASONABLE INTERVALS NOT TO EXCEED 200'. PASSING SPACE SHALL PROVIDE A 60" x 60" MINIMUM CLEAR SPACE AND MAY BE PROVIDED AT DRIVEWAYS, BUILDING ENTRANCES, AND SIDEWALK INTERSECTIONS.

		DESIGN AND CONSTRUCTION STANDARDS		
		<h1>SIDEWALK</h1>		
		DR. BY:	DATE:	<h2>SW-1</h2>
08/01/03	REV. FOR INTERNET 2003	CHK. BY:	DATE:	
DATE	REVISIONS	APP. BY:	DATE:	