
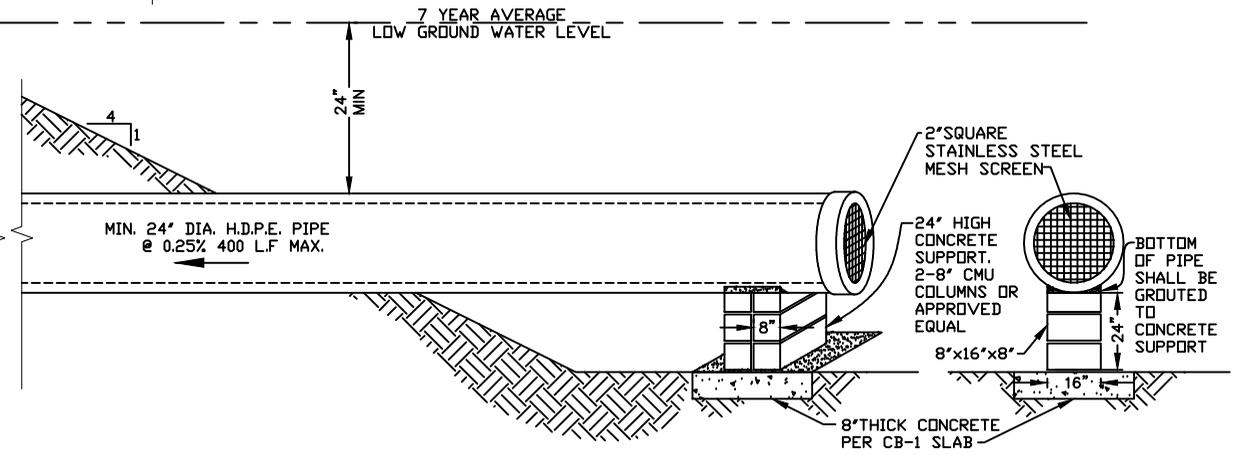
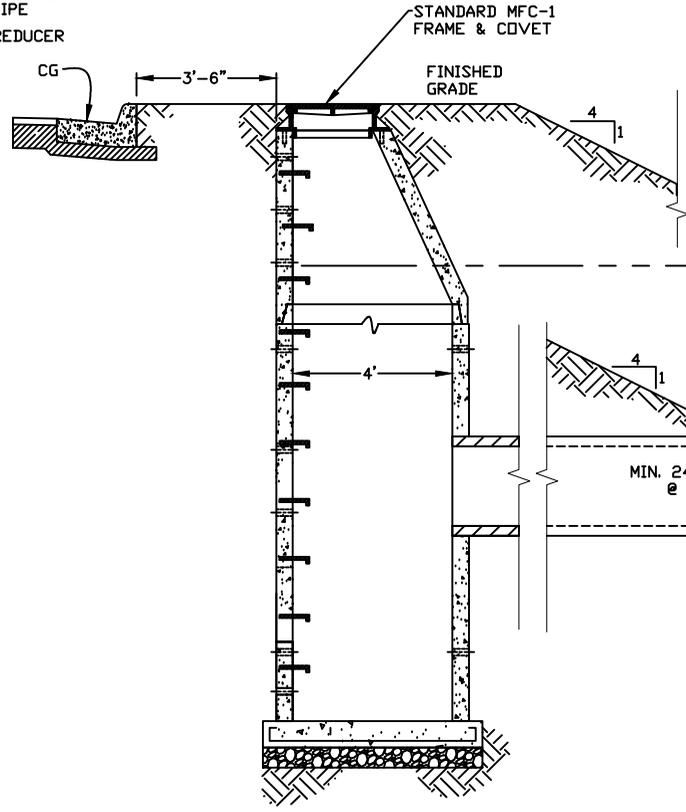
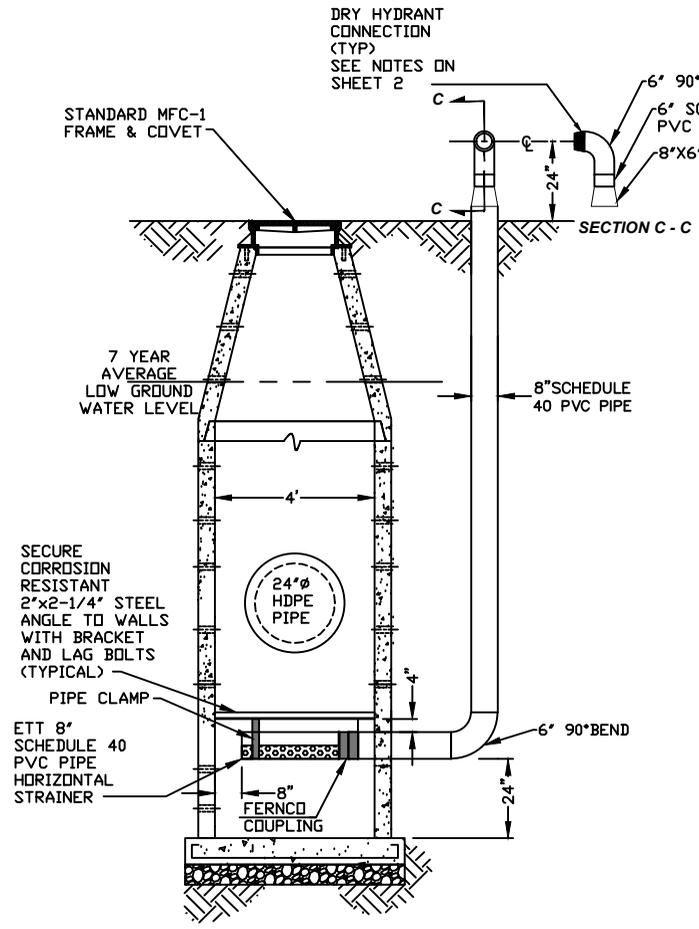


FIRE HYDRANT NOTES

1. CONTRACTOR INSTALLING DRY FIRE HYDRANT IS REQUIRED TO SECURE A FIRE PROTECTION SYSTEM INSTALLATION PERMIT WITH DETAILS AND CUT SHEETS SUBMITTED TO FIRE PREVENTION AND TO THE ENGINEER FOR APPROVAL PRIOR TO WORK.
2. MAINTENANCE OF DRY FIRE HYDRANTS MUST BE PREFORMED IN ACCORDANCE WITH THE FIRE CODE AND NFPA 1142.
3. ACCEPTANCE TESTING OF HYDRANTS MUST BE IN ACCORDANCE WITH CHESAPEAKE FIRE DEPARTMENT POLICY.
4. CENTER OF 6" DRY HYDRANT CONNECTIONS SHALL BE 24" ABOVE GRADE.
5. 24" HDPE PIPE SHALL BE ANCHORED TO CONCRETE SUPPORTS BY STAINLESS STEEL STRAPS OR IN ACCORDANCE WITH MANUFACTURES REQUIREMENTS TO PREVENT FLOATATION.

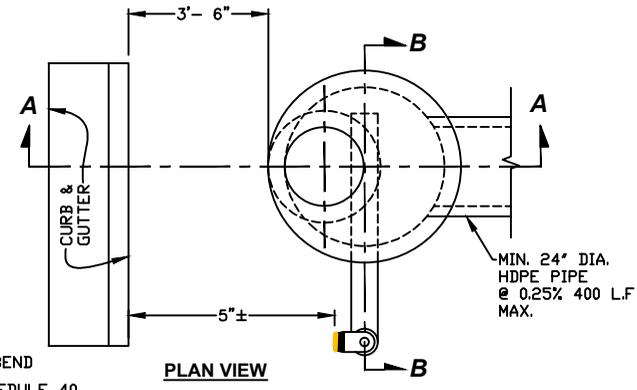

MH-2 WITH DRY HYDRANT CONNECTION
(SEE MH-2 STANDARD FOR DETAILS)
SECTION B - B
(No Scale)

MH-2 WITH DRY HYDRANT CONNECTION
(SEE MH-2 STANDARD FOR DETAILS)
SECTION A - A
(No Scale)

SHEET 1 OF 2

	DESIGN AND CONSTRUCTION STANDARDS	
	MH-2 WITH DRY HYDRANT CONNECTION	
/ /	REVIEWED PFM 2013 EDITION FOR WEB	DR. BY: <i>R_w</i> DATE: / /
DATE	REVISIONS	CHK. BY: DATE: / /
		APP. BY: DATE: / /

MH2-DHC

APPROVED Date: / /