



EXPLODED VIEW OF DRY HYDRANT CONNECTION

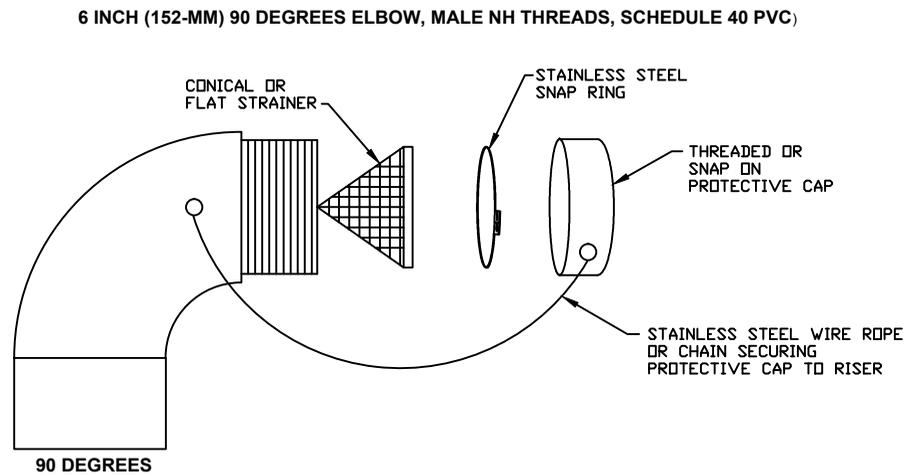


12"x18" ALUMINUM POST SIGN OR
 6"x12" REFLECTIVE SELF-ADHESIVE LABEL

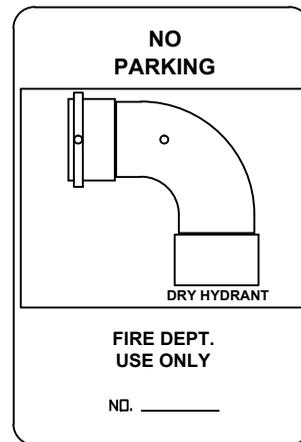

DRY HYDRANT NOTES:

1. DRY HYDRANT RISER, CONNECTION HEAD & PIPING SCHEDULE 40 PVC
2. DRY HYDRANT CONNECTION & RISER HEIGHT 24 INCHES AT CENTERLINE
3. SIGNAGE & MARKING:
 FIRE LANE SIGNS & PAVEMENT MARKING (WHERE PAVED) REQUIRED TO PROTECT EMERGENCY ACCESS TO DRY HYDRANT CONNECTION AREA FROM OBSTRUCTIONS - SEE PFM, APPENDIX 19.
 ALSO, UTILIZE EITHER REFLECTIVE SELF-ADHESIVE LABEL AFFIXED TO THE CONNECTION RISER OR ONE FREE STANDING ALUMINUM POST SIGN TO INDICATE DRY HYDRANT CONNECTION - FIRE DEPT. USE ONLY - SEE SIGN DETAIL BELOW
4. BOLLARD PROTECTION MAY BE REQUIRED AS DEEMED NECESSARY

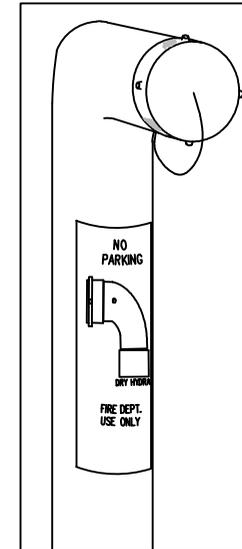

SHEET 2 OF 2

Chesapeake VIRGINIA	DESIGN AND CONSTRUCTION STANDARDS	
	MH-2 WITH DRY HYDRANT CONNECTION	
/ /	REVIEWED PFM 2013 EDITION FOR WEB	DR. BY: <i>R_N</i> DATE: _____ CHK. BY: _____ DATE: _____ APP. BY: _____ DATE: _____
DATE	REVISIONS	MH2-DHC

APPROVED Date: ____/____/____