



METHOD OF TREATMENT IN DROP INLETS

NOTES

SHAPING INVERTS IN ACCORDANCE WITH THIS DRAWING IS TO APPLY TO ALL DRAINAGE STRUCTURES. FURNISHING AND PLACING ALL MATERIALS IS TO BE INCLUDED IN THE PRICE BID FOR THE PARTICULAR ITEM.

DRAINAGE STRUCTURE IS TO BE FORMED AND CONSTRUCTED IN ACCORDANCE WITH APPLICABLE STANDARD OR SPECIAL DRAWING. THE INVERT SHAPING AS DETAILED HEREON IS TO CONSIST OF A PORTLAND CEMENT CONCRETE MIX CONFORMING TO CLASS A3 OR CLASS C1, EXCEPT THAT 25% OF COARSE AGGREGATE MAY BE UP TO 4" IN DIAMETER AND CONSIST OF STONE, BROKEN BRICK, BROKEN CONCRETE, OR BROKEN CONCRETE BLOCK. THE SURFACE SHALL BE LEFT SMOOTH BY MEANS OF HAND TROWELING. NONE OF THE COARSE AGGREGATE SHALL REMAIN EXPOSED.

DETAILS OF INVERT SHAPING AS SHOWN HEREON ARE FOR EXAMPLE PURPOSES ONLY. EACH MANHOLE OR DROP INLET IS TO BE SHAPED INDIVIDUALLY TO BEST FIT THE PARTICULAR INLET AND OUTLET CONFIGURATION AND FLOW LINES.

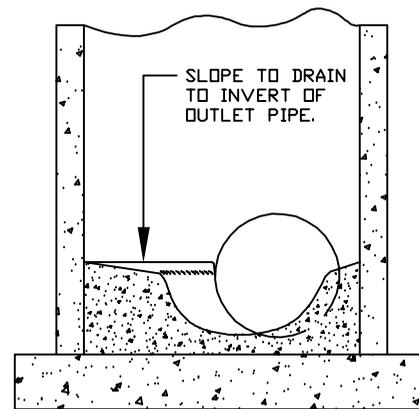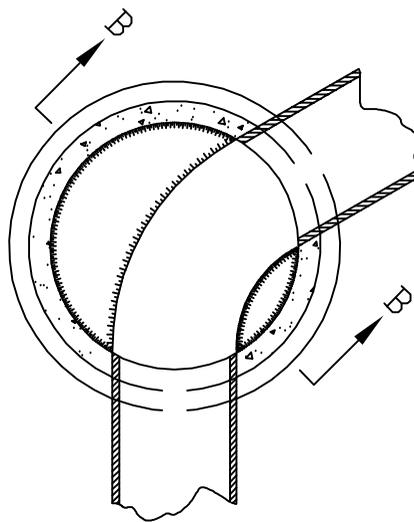

SECTION B-B

METHOD OF TREATMENT IN MANHOLES

		DESIGN AND CONSTRUCTION STANDARDS	
		SHAPING OF MANHOLE, DROP INLET, AND CATCH BASIN INVERTS	
08/01/03	REV. FOR INTERNET 2003	DR. BY:	DATE:
DATE	REVISIONS	CHK. BY:	DATE:
		APP. BY:	DATE:

IS-1