


SECTION A-A

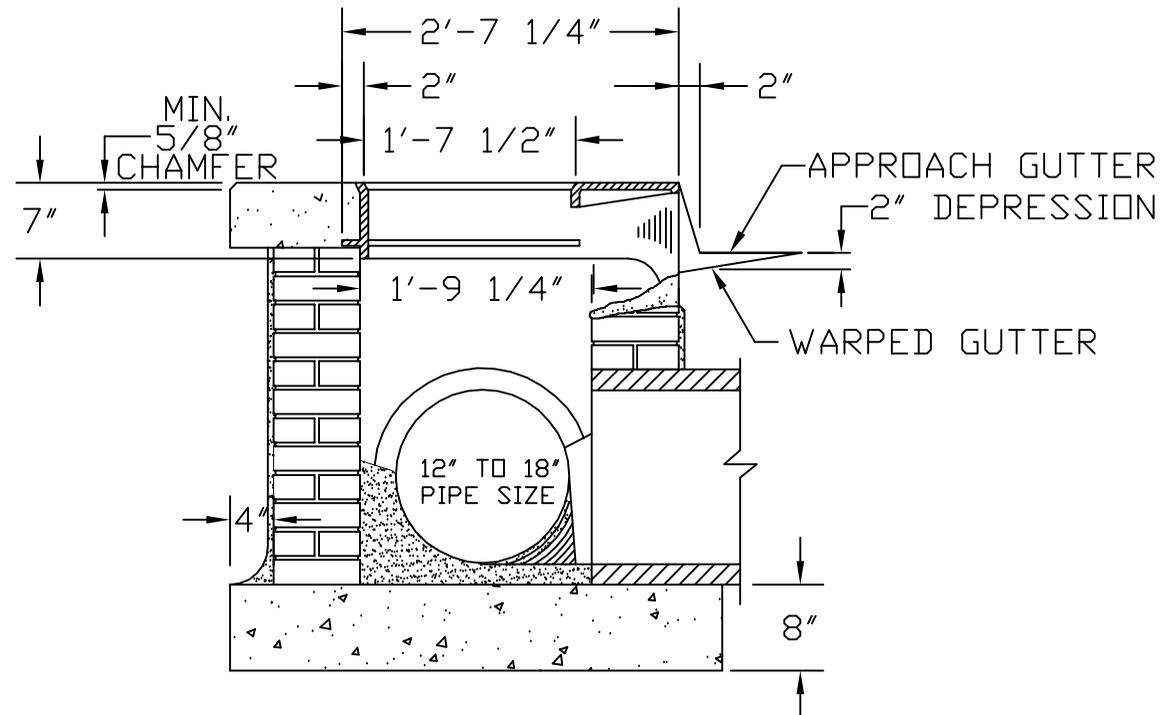

SECTION B-B

FOUNDATION TO BE CLEAN AND DRY PRIOR TO INSTALLATION OF BRICK AND PLASTERED FINISH. BRICK SHALL BE OF THE (3)THREE HOLE TYPE. BRICK MASONRY SHALL BE LAID SO THAT EACH UNIT WILL BE THOROUGHLY BONDED WITH MORTAR. SUCH JOINTS SHALL BE CONSTRUCTED BY THE SHOVE JOINT METHOD AND THE WIDTH OF THE FINISHED JOINTS IN THE FACE SHALL NOT BE GREATER THAN THREE EIGHTS INCH (3/8"). WHERE BRICK MASONRY IS USED, THE HEADER AND STRETCHER COURSES SHALL ALTERNATE TO FULLY BOND THE MASS. THE INSIDE JOINTS SHALL BE NEATLY POINTED AND THE OUTSIDE OF SUCH WALLS, AS THEY ARE LAID, SHALL BE PLASTERED WITH MORTAR.

THE INVERT IS TO BE SHAPED IN ACCORDANCE WITH STANDARD PLAN IS-1. FURNISHING AND PLACING ALL MATERIALS INCIDENTAL TO THE SHAPING IS TO BE INCLUDED IN THE PRICE BID.

CHES. STD. ST-1 STEPS SHALL BE PROVIDED IN ALL CATCH BASINS DEEPER THAN FOUR FEET. 24' MAX FROM RIM TO FIRST STEP

SHEET 3 OF 3

		DESIGN AND CONSTRUCTION STANDARDS	
		CATCH BASIN BRICK (12" -18" PIPE) MAX. DEPTH 6'	
08/01/03	REV. FOR INTERNET 2003	DR. BY:	DATE:
DATE	REVISIONS	CHK. BY:	DATE:
		APP. BY:	DATE:
			CB-1

APPROVED FOR THE WEB _____
 City Engineer _____ Date _____