


# Chesapeake modifications to Regional Standards Third Edition

1. A minimum of one 4 inch adjustment ring to be added at time of construction to allow for future adjustments.
2. Casting to be placed over the outlet pipe.
3. Watertight insert to be provided with casting in accordance with Volumes I & III of PFM.
4. No laterals allowed in cone section without approval of the Utility Engineer.

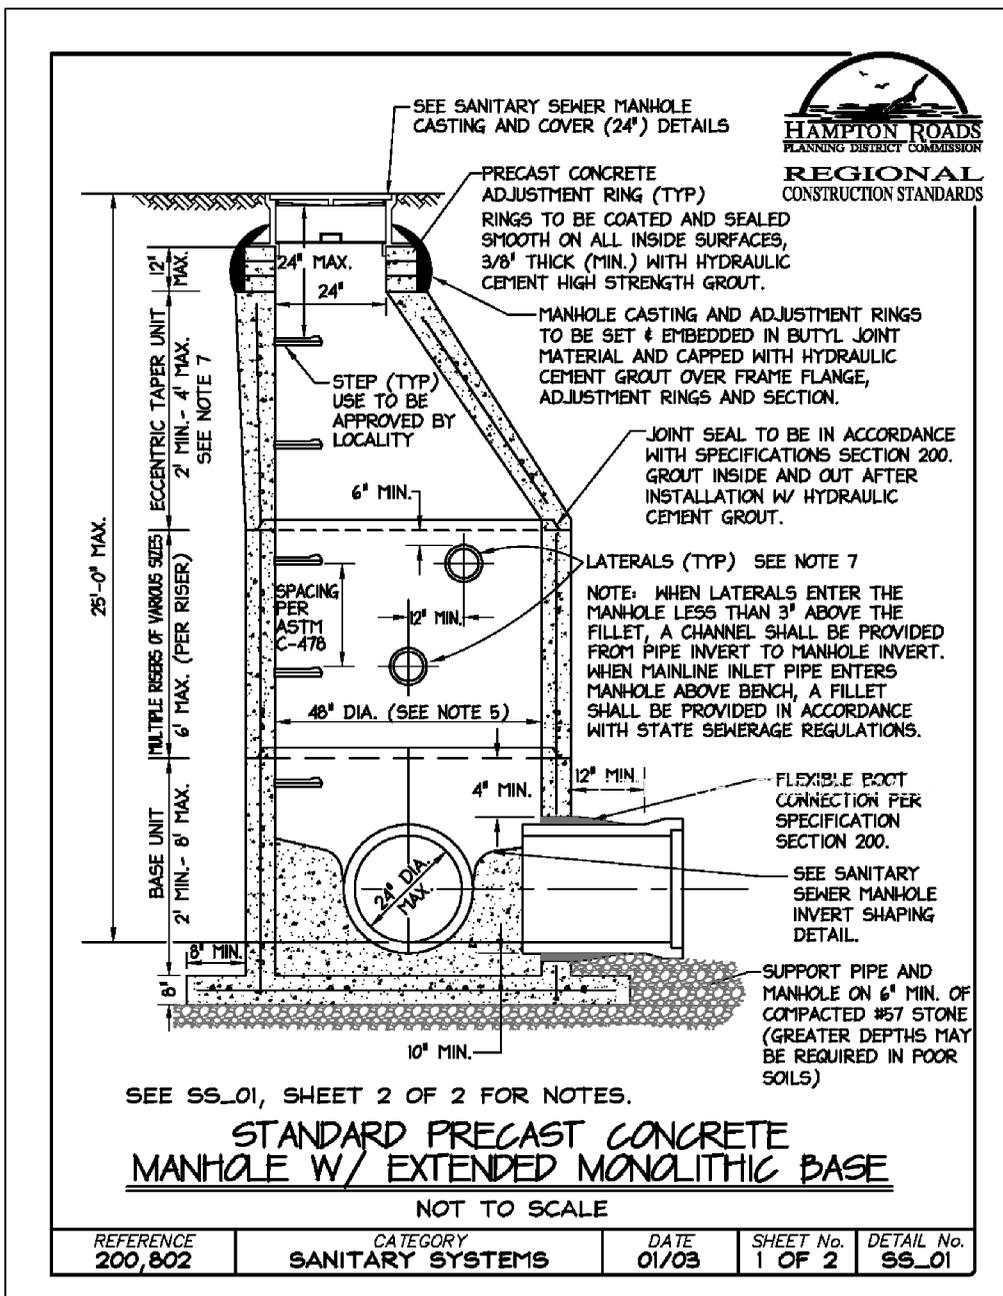

Regional Construction  
Standards  
Third Edition

SHEET 1 OF 2

		DESIGN AND CONSTRUCTION STANDARDS	
		<b>STANDARD PRECAST CONCRETE MANHOLE WITH EXTENDED MONOLITHIC BASE</b>	
		DR. BY:	DATE:
08/15/03	REV. FOR INTERNET 2003	CHK. BY:	DATE:
DATE	REVISIONS	APP. BY:	DATE:
			<b>SS_01</b>

APPROVED FOR THE WEB

Utility Engineer

Date