


Chesapeake modifications to Regional Standards Third Edition

1. A minimum of one 4 inch adjustment ring to be added at time of construction to allow for future adjustments.
2. After grouting lift holes they shall be field coated as noted in note 3 on drawing.
3. On manholes greater than 12 feet deep the inside diameter of the entire manhole shall be 60 inches except for the cone section.
4. Casting to be placed over the outlet pipe.
5. Watertight insert to be provided with casting in accordance with Volume I & III of PFM.

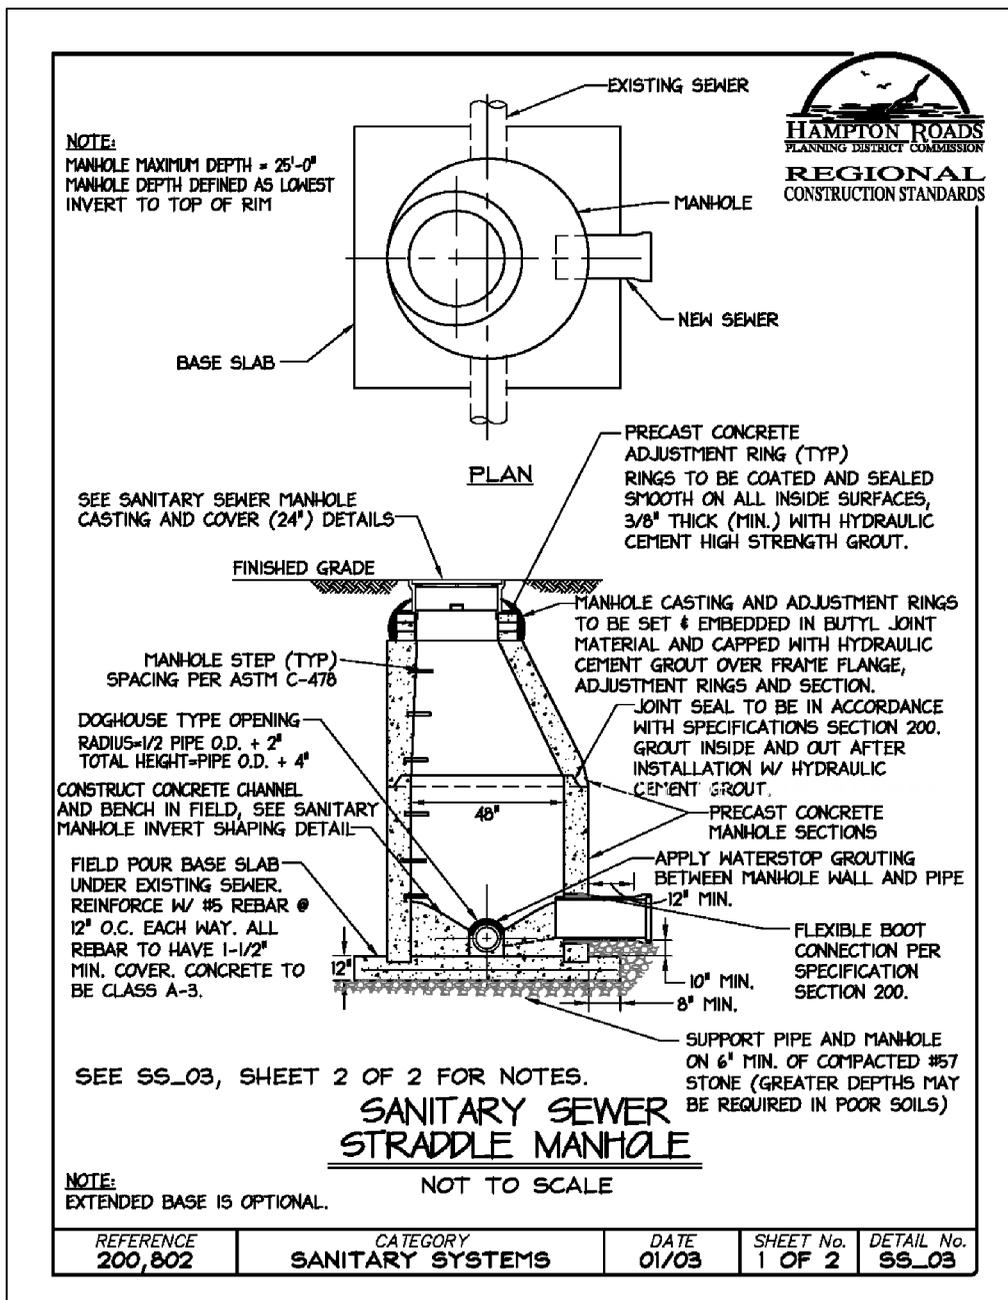

Regional Construction Standards Third Edition

SHEET 1 OF 2

		DESIGN AND CONSTRUCTION STANDARDS			
		SANITARY SEWER STRADDLE MANHOLE			
DR. BY:	DATE:	SS_03	04		
08/15/03	REV. FOR INTERNET 2003			CHK. BY:	DATE:
DATE	REVISIONS			APP. BY:	DATE:

APPROVED FOR THE WEB

Utility Engineer

Date