



2 1-3/8" HOLES TO BE DRILLED IN THE TOP, 6" APART, MEASURED FROM CENTER TO CENTER. HOLES TO BE LOCATED IN LOWER RIGHT CORNER ON INLET END OF THE METER.

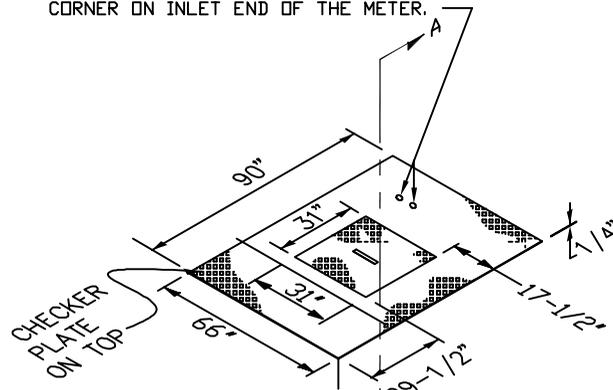


TOP

NTS

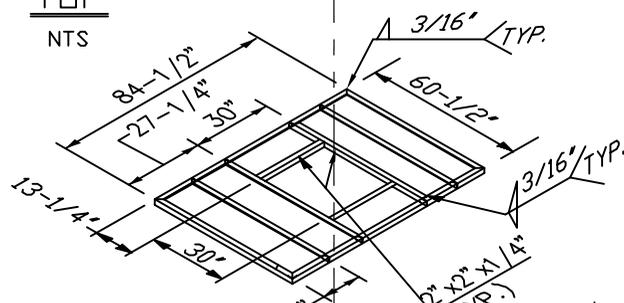

FRAME



NTS

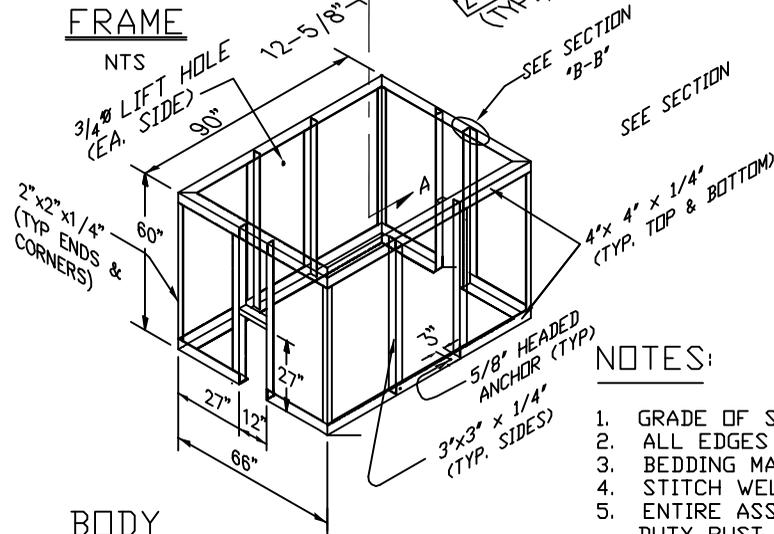

BODY


NTS

2" ID - LIFTING HOLES 4 CORNERS - 1" FROM EACH EDGE

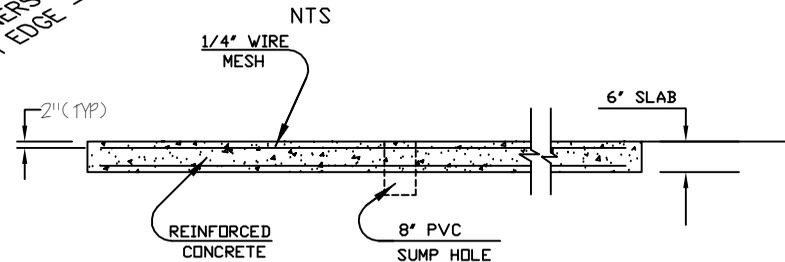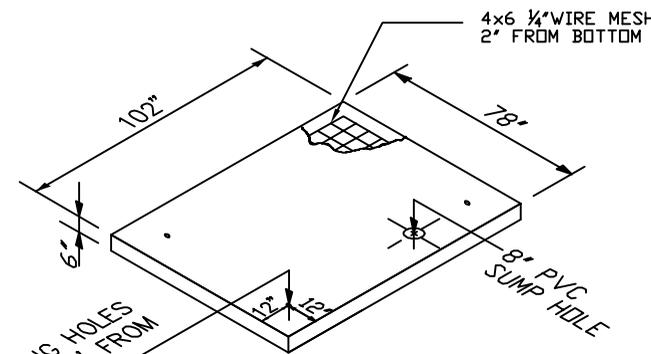

CONCRETE SLAB

NTS

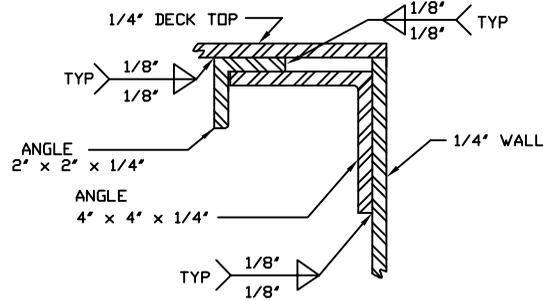


SECTION A-A

NTS


NOTES:

1. GRADE OF STEEL SHALL BE A36.
2. ALL EDGES TO BE GROUND SMOOTH.
3. BEDDING MATERIAL AROUND BOX TO BE SELECT MATERIAL.
4. STITCH WELD TOP TO FRAME WITH 3" BEAD ON 6" C-C.
5. ENTIRE ASSEMBLY TO BE COATED WITH COATS OF HEAVY-DUTY RUST INHABITIVE INTERMEDIATE PRIMER AND TWO COATS OF BLACK RUST OLEUM.

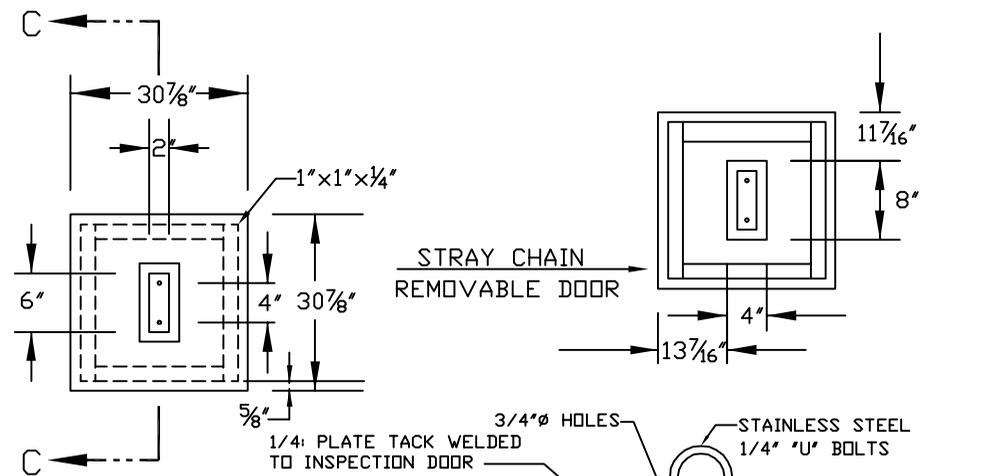

INSPECTION DOOR

NTS

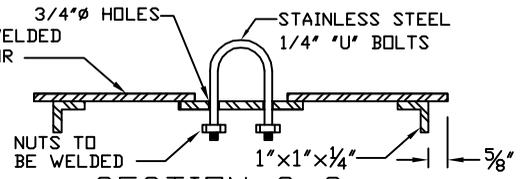


SECTION C-C

NTS


NOTE TO USER:

THIS BOX IS NOT TO BE USED IN STREETS, ALLEYS, OR ANY AREA EXPOSED TO VEHICULAR TRAFFIC.

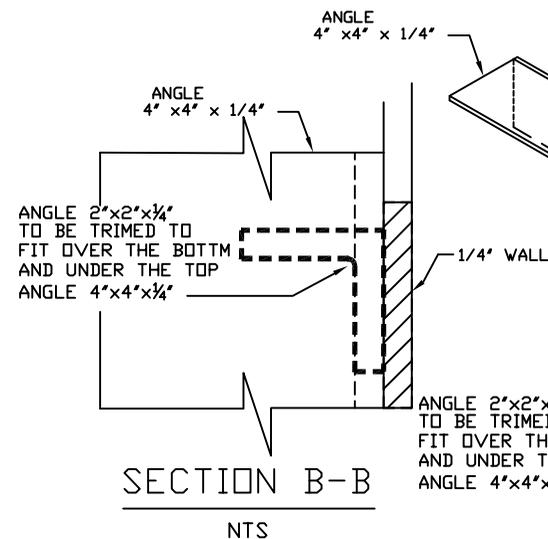

SECTION B-B

NTS

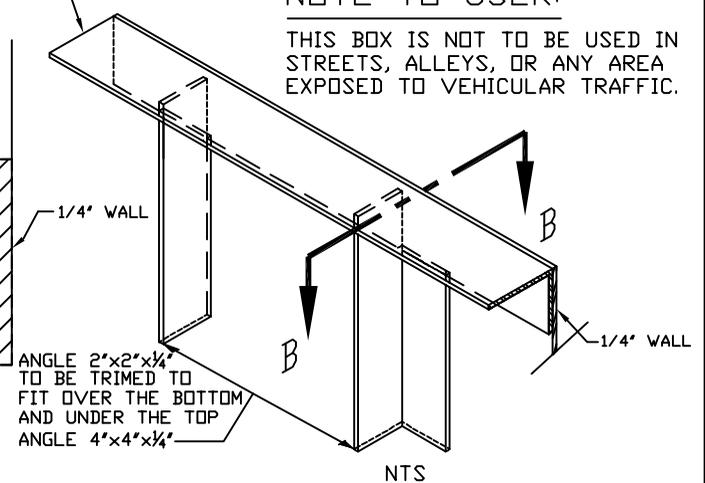

NTS

Chesapeake VIRGINIA

DESIGN AND CONSTRUCTION STANDARDS

METER VAULT DETAIL/SPECS
METER SIZE 3" TO 8"

08/15/03	REV. FOR INTERNET 2003	DR. BY:	DATE:
DATE	REVISIONS	CHK. BY:	DATE:
		APP. BY:	DATE:

WMV-2

15