


Chesapeake modifications to Regional Standards Third Edition

1. No thrust block to be installed on the tee for the hydrant.
2. Valves to be MJ X MJ and located 3 feet from the water main.
3. Minimum distance behind curb to be 18 inches.
4. 90° bend to be MJ X MJ. Foster Adaptors may be used at each end.

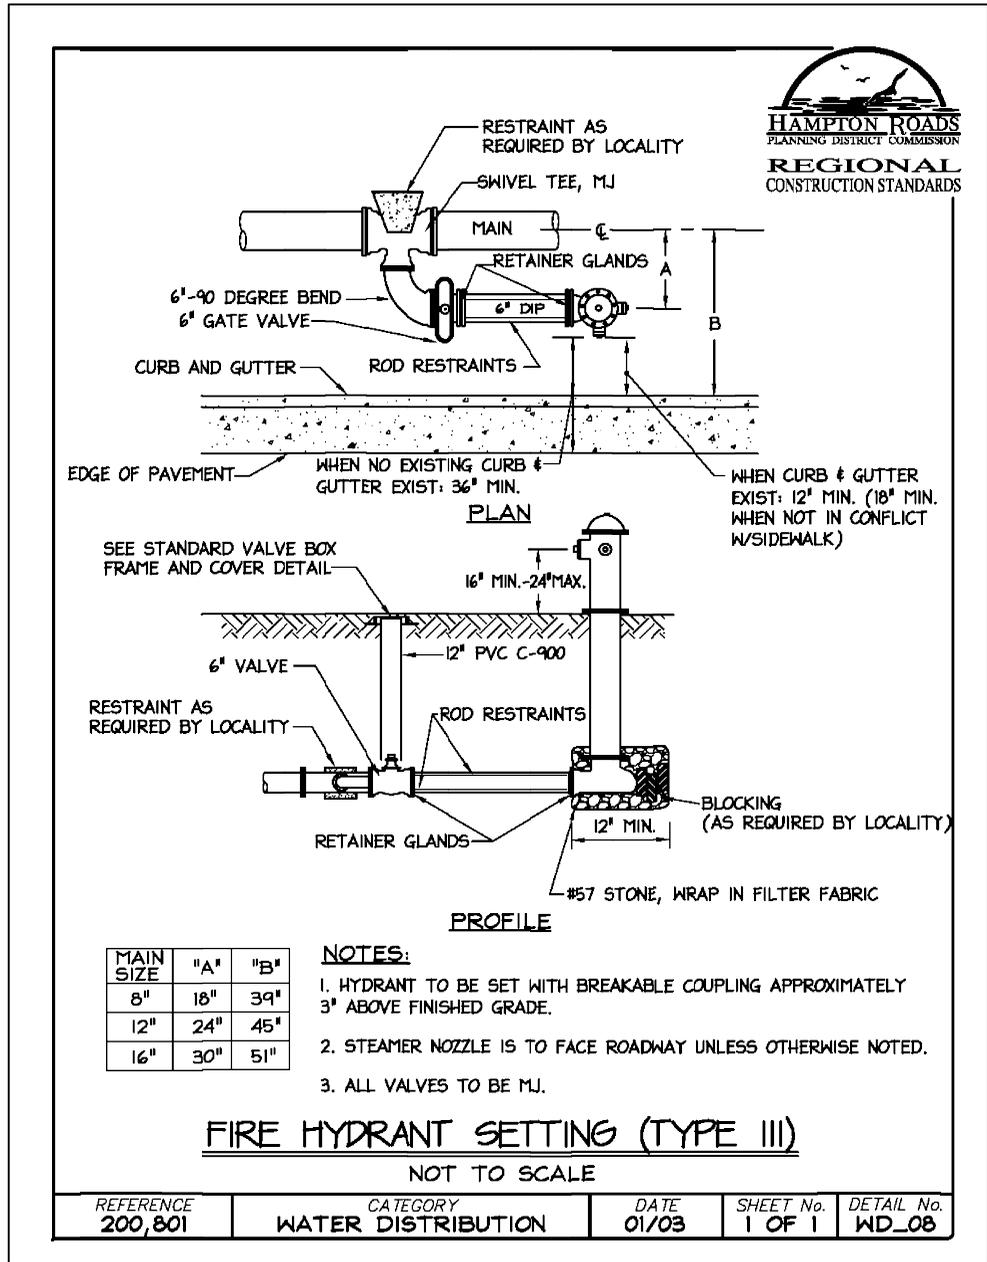

Regional Construction
Standards
Third Edition

		DESIGN AND CONSTRUCTION STANDARDS			
		FIRE HYDRANT SETTING (TYPE III)			
DR. BY:	DATE:	WD_08	09		
08/15/03	REV. FOR INTERNET 2003			CHK. BY:	DATE:
DATE	REVISIONS			APP. BY:	DATE:

APPROVED FOR THE WEB

Utility Engineer

Date