



NOTE:

MARK WITH A "W" FOR WATER DISTRIBUTION SYSTEMS OR "S" FOR SANITARY SYSTEMS. TOP & BOTTOM OF LETTER DESIGNATION TO BE IN LINE WITH NOTCHES.

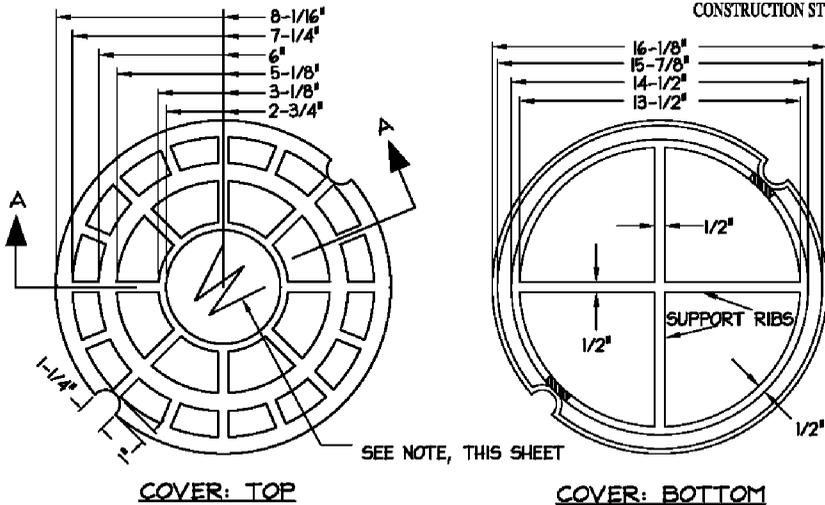

BOTTOM SUPPORT RING TO BE NOTCHED DIRECTLY UNDER PICK HOLE ON BOTH SIDES. NOTCHES TO BE CENTERED BETWEEN SUPPORT RIBS.

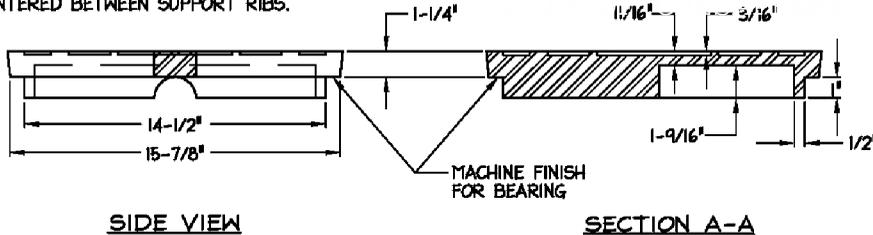

SEE WS_01, SHEET 2 OF 2 FOR NOTES & FRAME DETAILS.

**STANDARD VALVE BOX
FRAME AND COVER**

NOT TO SCALE

REFERENCE 200, 801, 803	CATEGORY WATER & SANITARY	DATE 01/03	SHEET No. 1 OF 2	DETAIL No. WS_01
----------------------------	------------------------------	---------------	---------------------	---------------------

Regional Construction
Standards
Third Edition

SHEET 1 OF 2



DESIGN AND CONSTRUCTION STANDARDS

**STANDARD VALVE BOX
FRAME AND COVER**

08/15/03	REV. FOR INTERNET 2003	DR. BY:	DATE:
DATE	REVISIONS	CHK. BY:	DATE:
		APP. BY:	DATE:

WS_01

01