


Chesapeake modifications to Regional Standards Third Edition

Two spacers will be used on each joint of pipe within the casing.

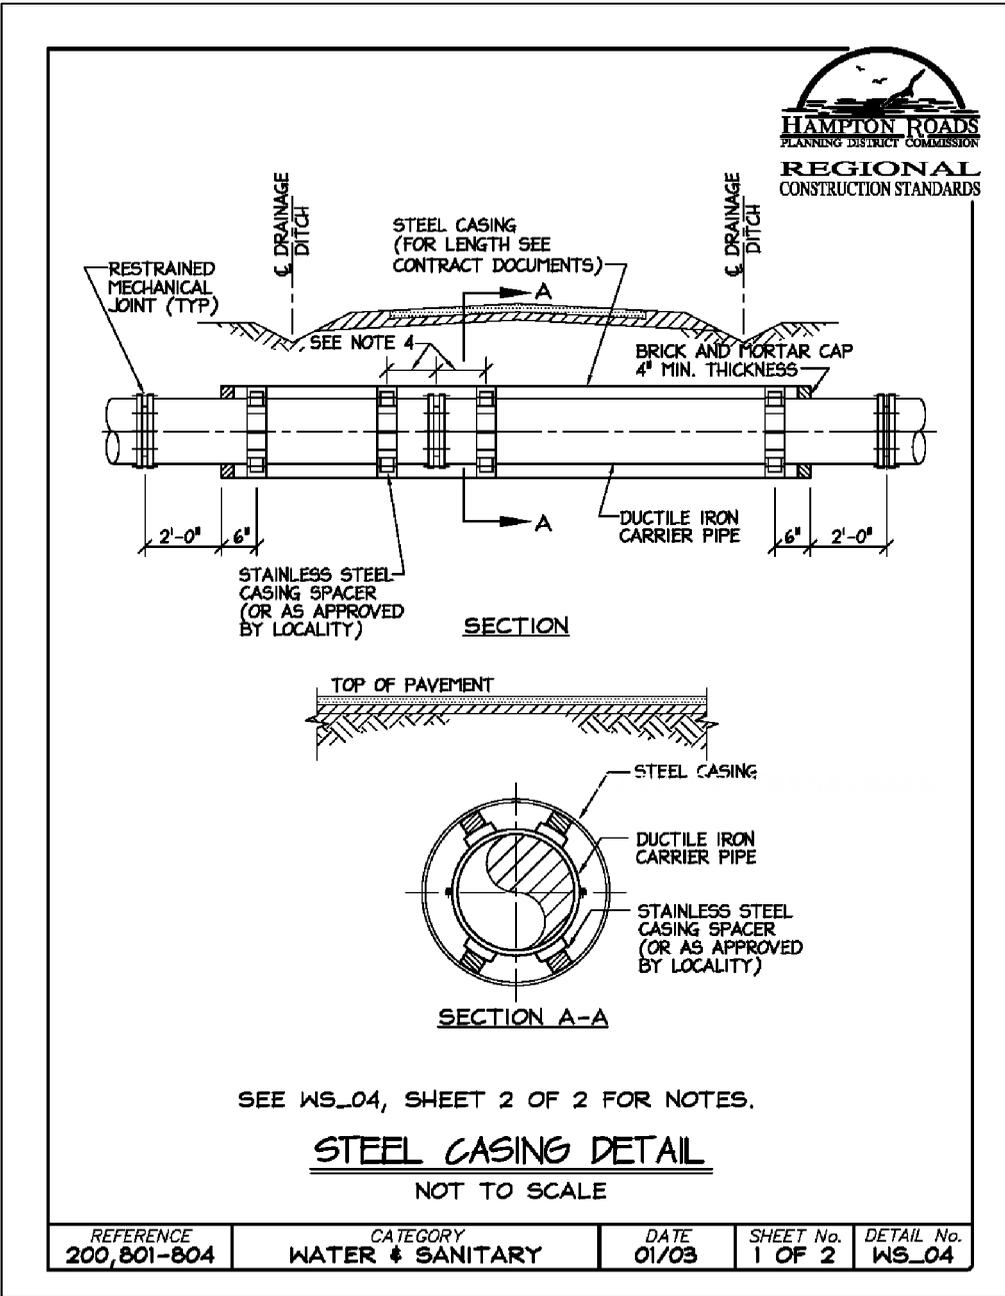

\_04\_1.tif

SHEET 1 OF 2



DESIGN AND CONSTRUCTION STANDARDS

STEEL CASING DETAIL

08/15/03	REV. FOR INTERNET 2003	DR. BY:	DATE:
DATE	REVISIONS	CHK. BY:	DATE:
		APP. BY:	DATE:

**WS\_04**

05